


APPENDIX B


Locations used for Emergency Discharges

The over-pumping locations shown in this appendix are those used in the winter of 2013/14. When over-pumping is necessary, sites will be selected to provide the most effective arrangements to maintain services, whilst minimising environmental effects. Where practical, sites that have been used previously are expected to be re-used (when necessary), but the use of different locations cannot be ruled out, if hydraulic conditions dictate.


Pump A - East St, Hambledon - Overpumping and Tankering Sites (Sheet 1 of 8)

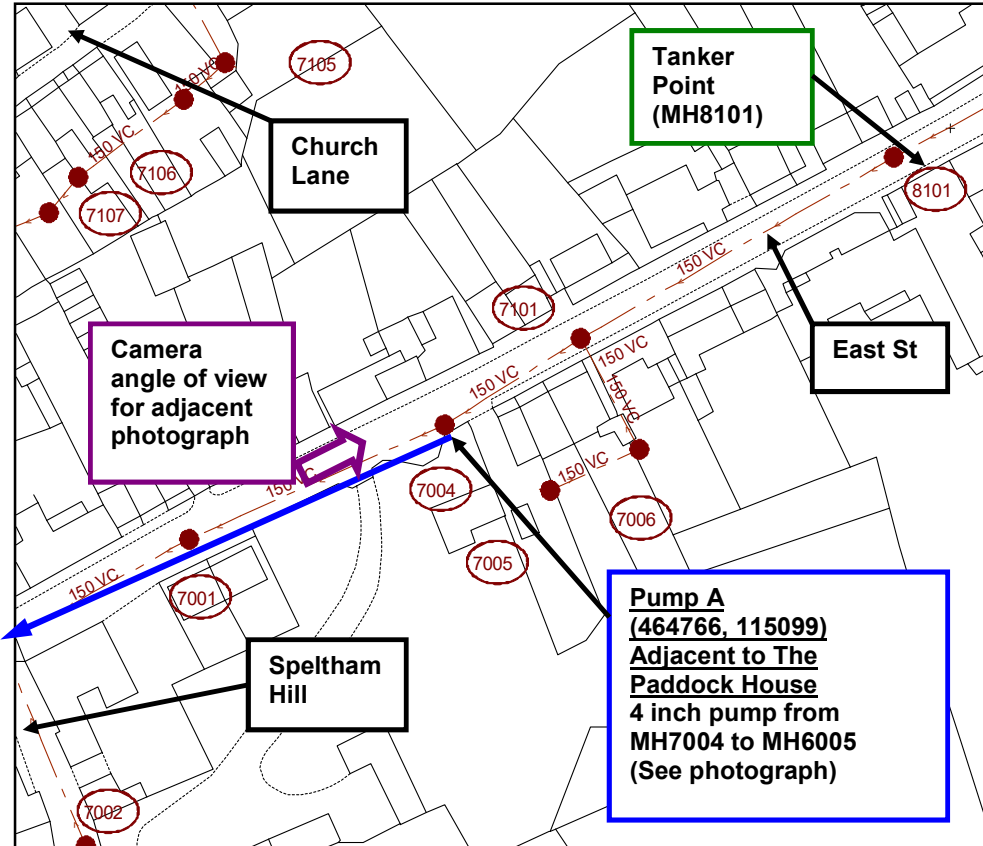


Pump B - Junction of East St and High St, Hambleton - Overpumping and Tankering Sites (Sheet 2 of 8)

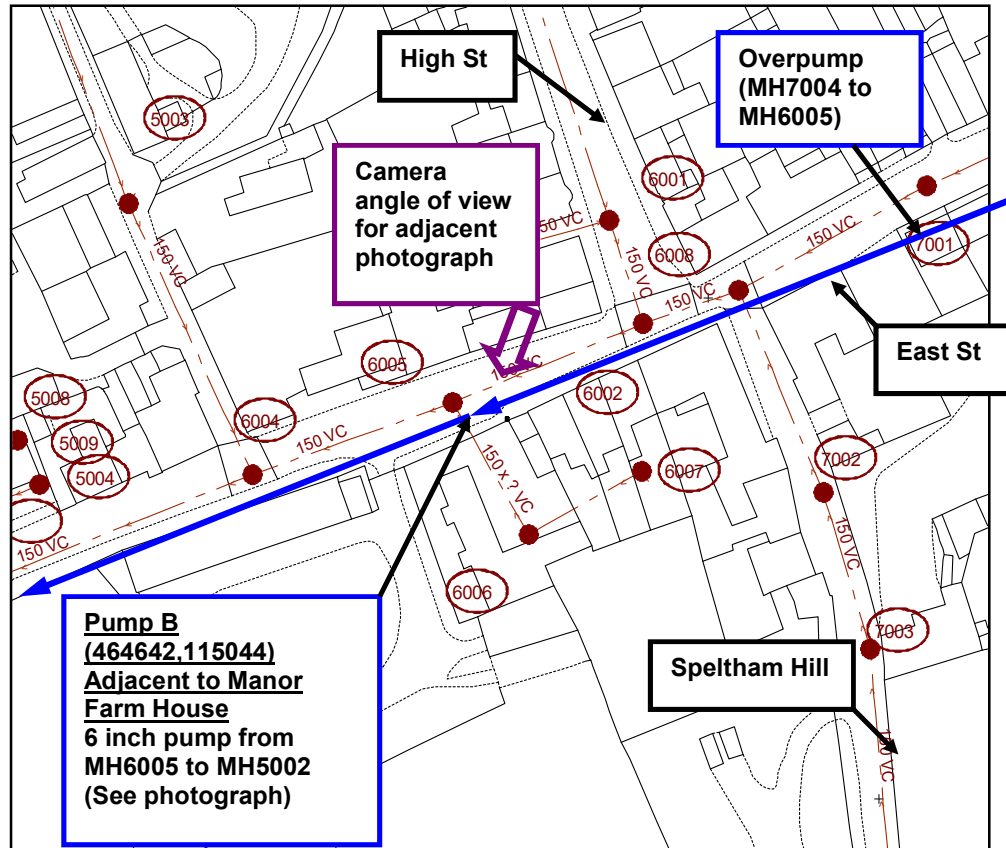


Pump C - West Street, Hambledon - Overpumping Sites (Sheet 3 of 8)

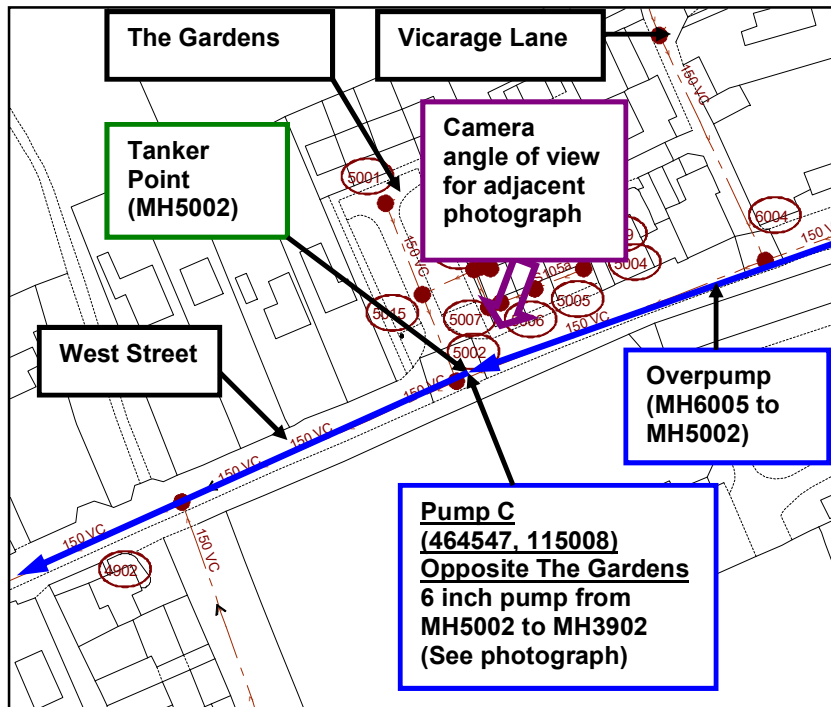


Pump E – Junction of Green Lane and West Street, Hambledon - Overpumping Sites (Sheet 5 of 8)

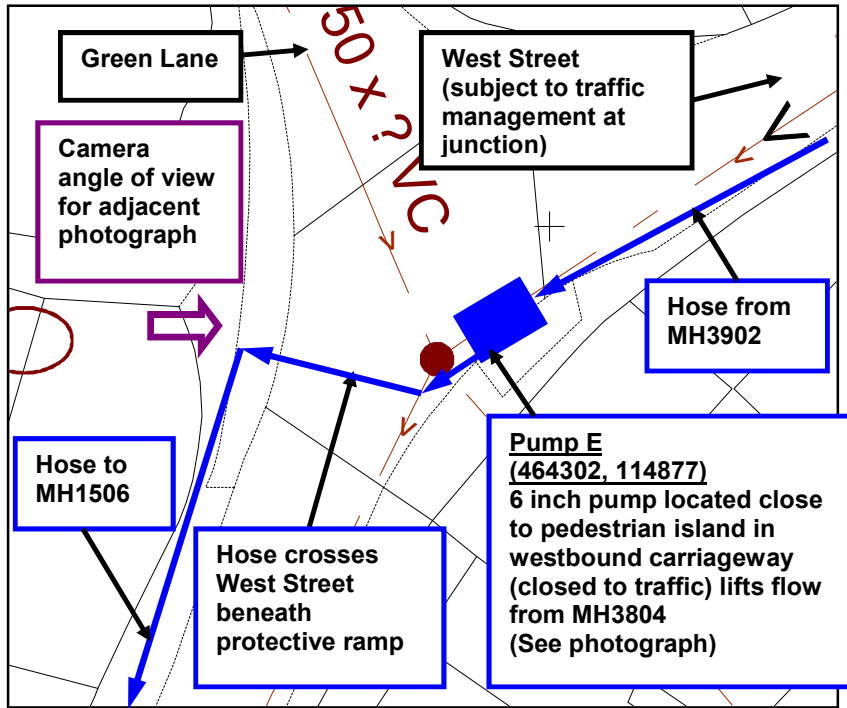


Pumps F and G, Old Barn Crescent, Hambledon - Overpumping Sites (Sheet 6 of 8)

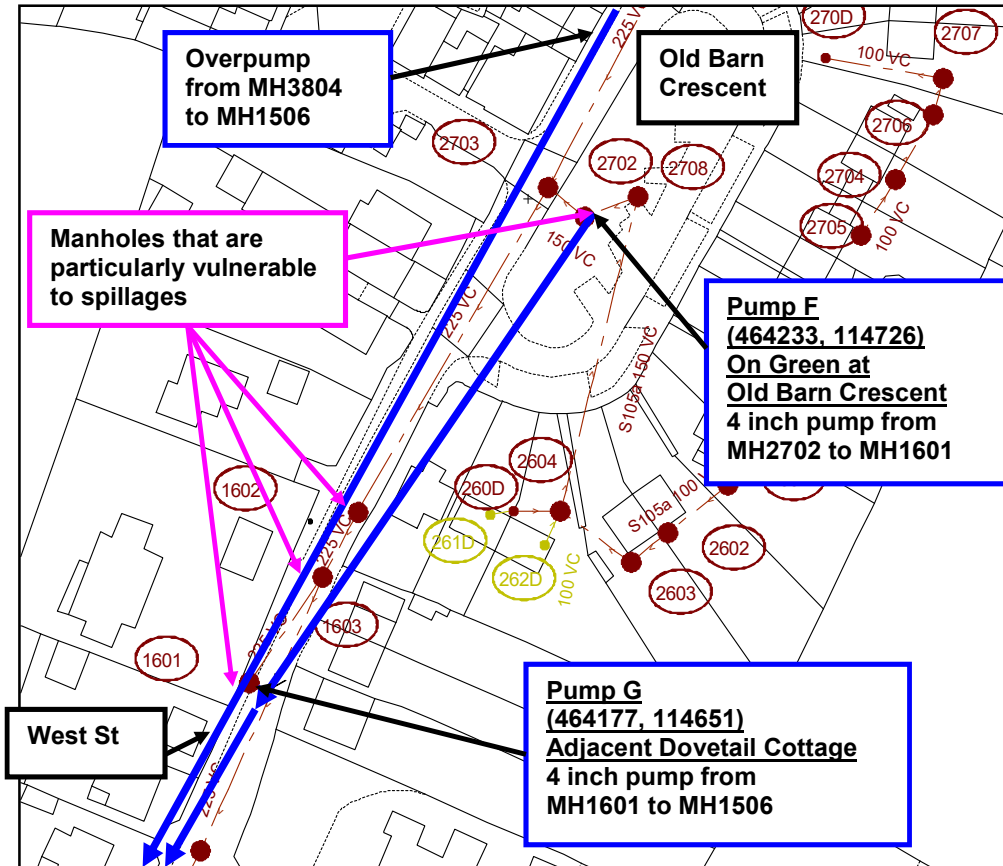

Pump H, Lotts Corner, Hambledon - Overpumping Sites (Sheet 7 of 8)

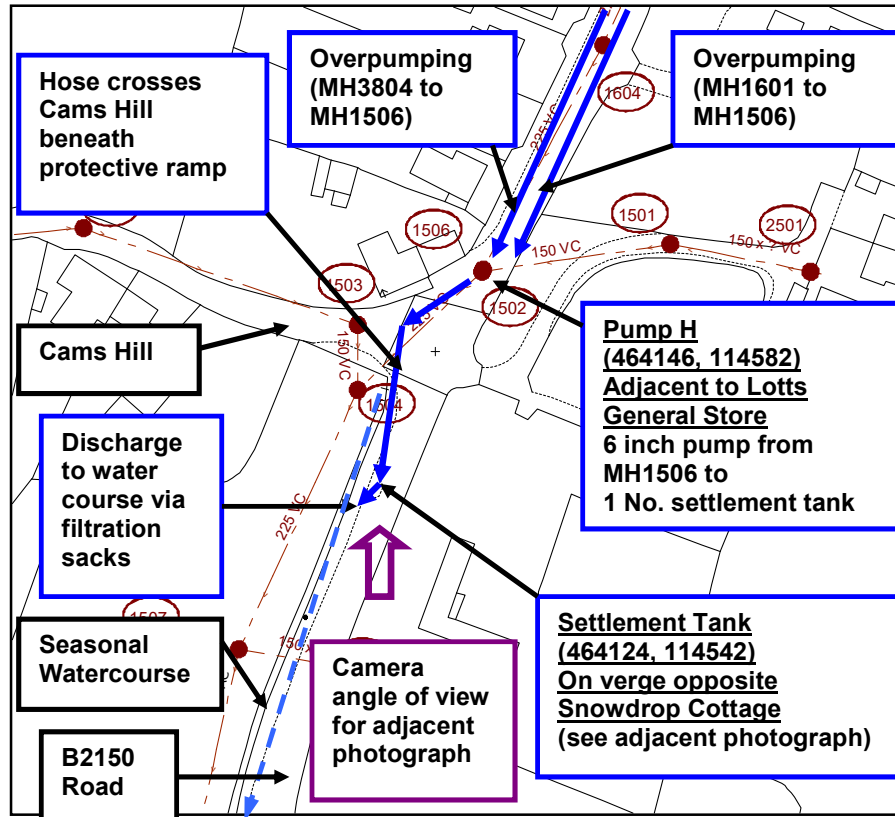

Pumps I & J, Bury Lodge WPS, Hambledon - Overpumping Site (Sheet 8 of 8)

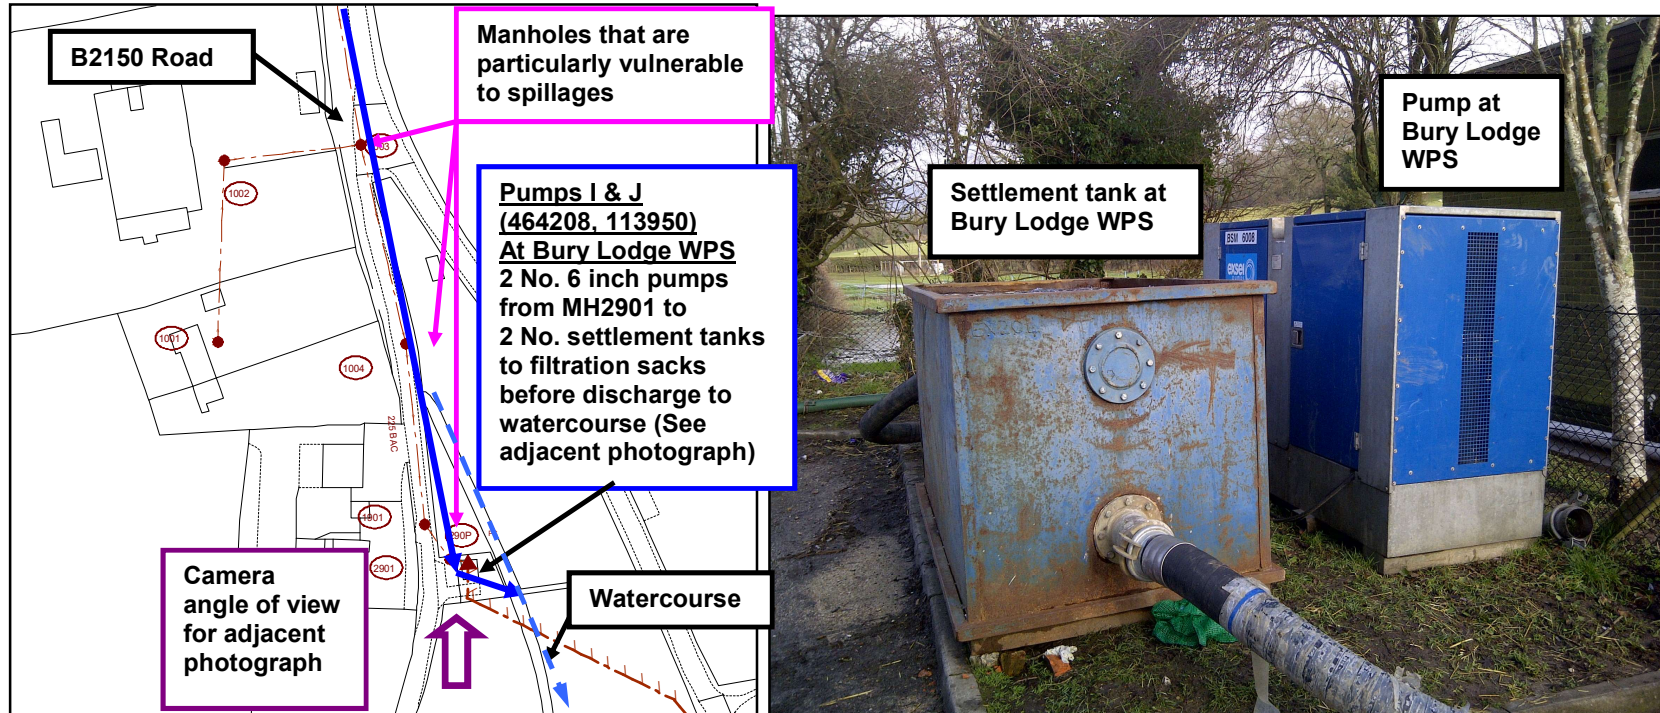

Timing for Deployment of Tankers and Overpumps in previous winters

**Date (+/- 1 day) Groundwater Level
(m AOD) at
Broadhalfpenny Down SW Activities in Hambledon**

08.01.14	75	Flooding issue became apparent at Bury Lodge WPS due to increase in flow.
09.01.14	78	Tankers deployed at Bury Lodge WPS following spillage of dilute sewage from manholes near pumping station.
17.01.14	71	Tankers deployed in village due to spillage of dilute sewage from manholes on Lower West St. One overpump deployed at Bury Lodge WPS to discharge into watercourse.
19.01.14	78	Second overpump (controlled by floats) deployed at Bury Lodge WPS to assist first pump when required.
21.01.14	78	Overpump deployed at Lotts Corner to discharge into ditch adjacent to the road. 5 No. tankers deployed in Hambledon village.
22 to 23.01.14	77	4 No. overpumps deployed from manhole to manhole from Lotts Corner to The Gardens. 2 No. overpumps remain at Bury Lodge. 6 No. tankers deployed in East St.
24.01.14	76	Additional overpump installed in East St in centre of the village. Number of tankers in East St reduced from 6 to 5.
25.01.14	76	Number of tankers in East St reduced from 5 to 4.
26.01.14	75	Number of tankers in East St reduced from 4 to 2.

**Date (+/- 1 day) Groundwater Level
(m AOD) at
Broadhalfpenny Down SW Activities in Hambledon**

04.02.14	74	Tanker deployed in Old Barn Crescent due to overflowing manhole
06.02.14	73	Four tankers deployed in Old Barn Crescent (and East St) to reduce risk of property flooding.
13.02.14	75	Additional overpump operational in Old Barn Crescent. Number of tankers reduced from 4 to 2.
02.03.14	67	Trial switching off of some overpumps, but levels rose rapidly so pumps restarted.
10.03.14	66	Overpumps removed from East St.
15.03.14	63	Majority of overpumps removed apart from pumps at Lotts Corner and Bury Lodge WPS
15.04.14	48 to 49m	Last remaining pump turned off
11.03.20	62.96	Start of tankering (1 no. tanker) continued to late spring.

No over-pumping or tankering was carried out in Hambledon in 2020/21.